

ANSI A137.1 Report

Regan Scientific Instruments

07/05/2013, 12:59P

Method: DCOF
Facility: 100
Location: 001
Result: 0.48
Distance: 08 in.
Temp/Hum: 84 F, 47%



1.



2.




3.




4.


1. Avg = 0.48, Min = 0.33, Max = 0.60

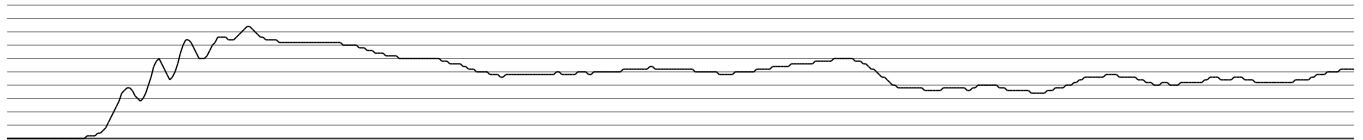


2. Avg = 0.47, Min = 0.34, Max = 0.52

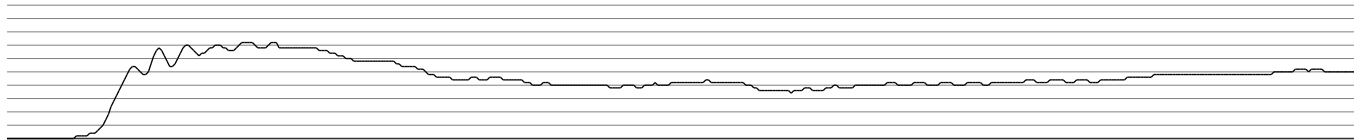

3. Avg = 0.49, Min = 0.20, Max = 0.60

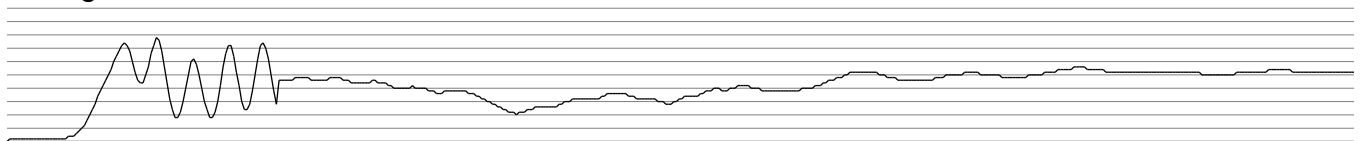

4. Avg = 0.47, Min = 0.28, Max = 0.58

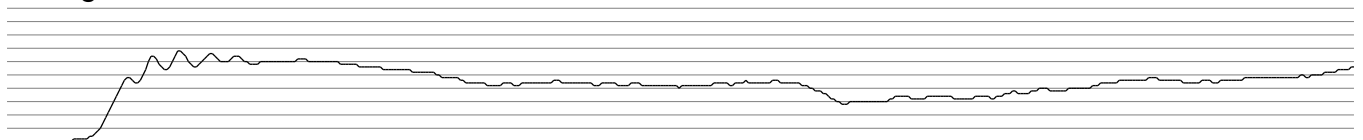

Device: BOT-3000E

Serial No: 00036

Calibration: 06/28/2013

Verification: 07/04/2013, 11:42A PASS

Slider: 00310

Type: Rubber

Manuf. date: 04/18/2013

Ref. offset: ----